


ESSW

Density of On Site Septic Systems in Close Proximity to Eastsound's Drinking Water Sources

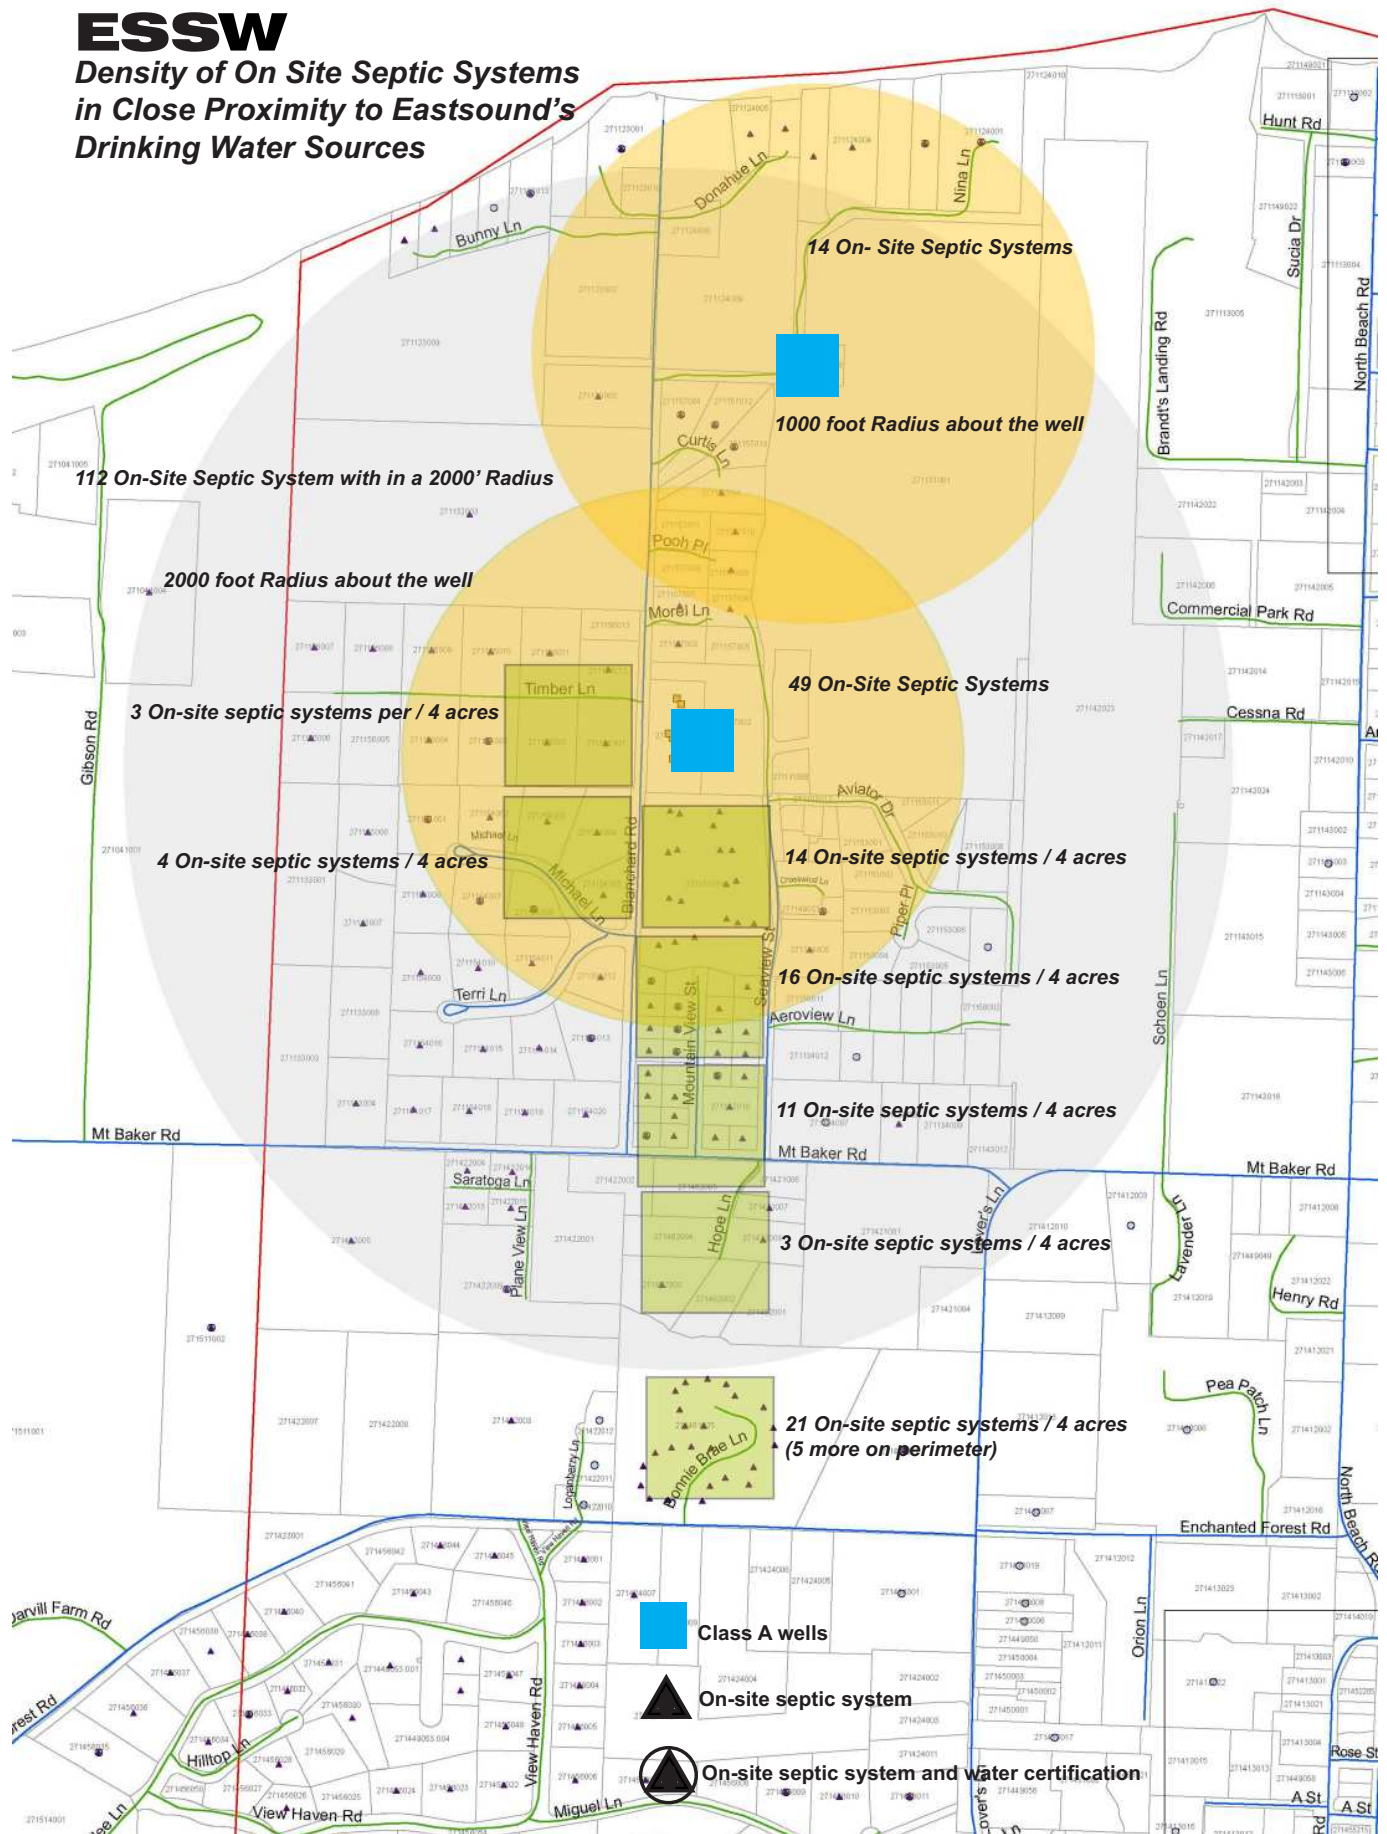

"Septic System Discharge Assessment" for Eastsound Sewer and Water District Prepared by the Chazen Companies. April 28, 2009.....Graphic Depictions of Concerns Expressed on Page 2, paragraphs 4 and 7, parcel density sizes and proximity to wells. Information compiled and based on County Polaris Maps by Eastsound Sewer and Water District Commissioner Carl Yurdin
December 14, 2009